Drawing No. 图号
SL4/B/00/OPD/P12/1013

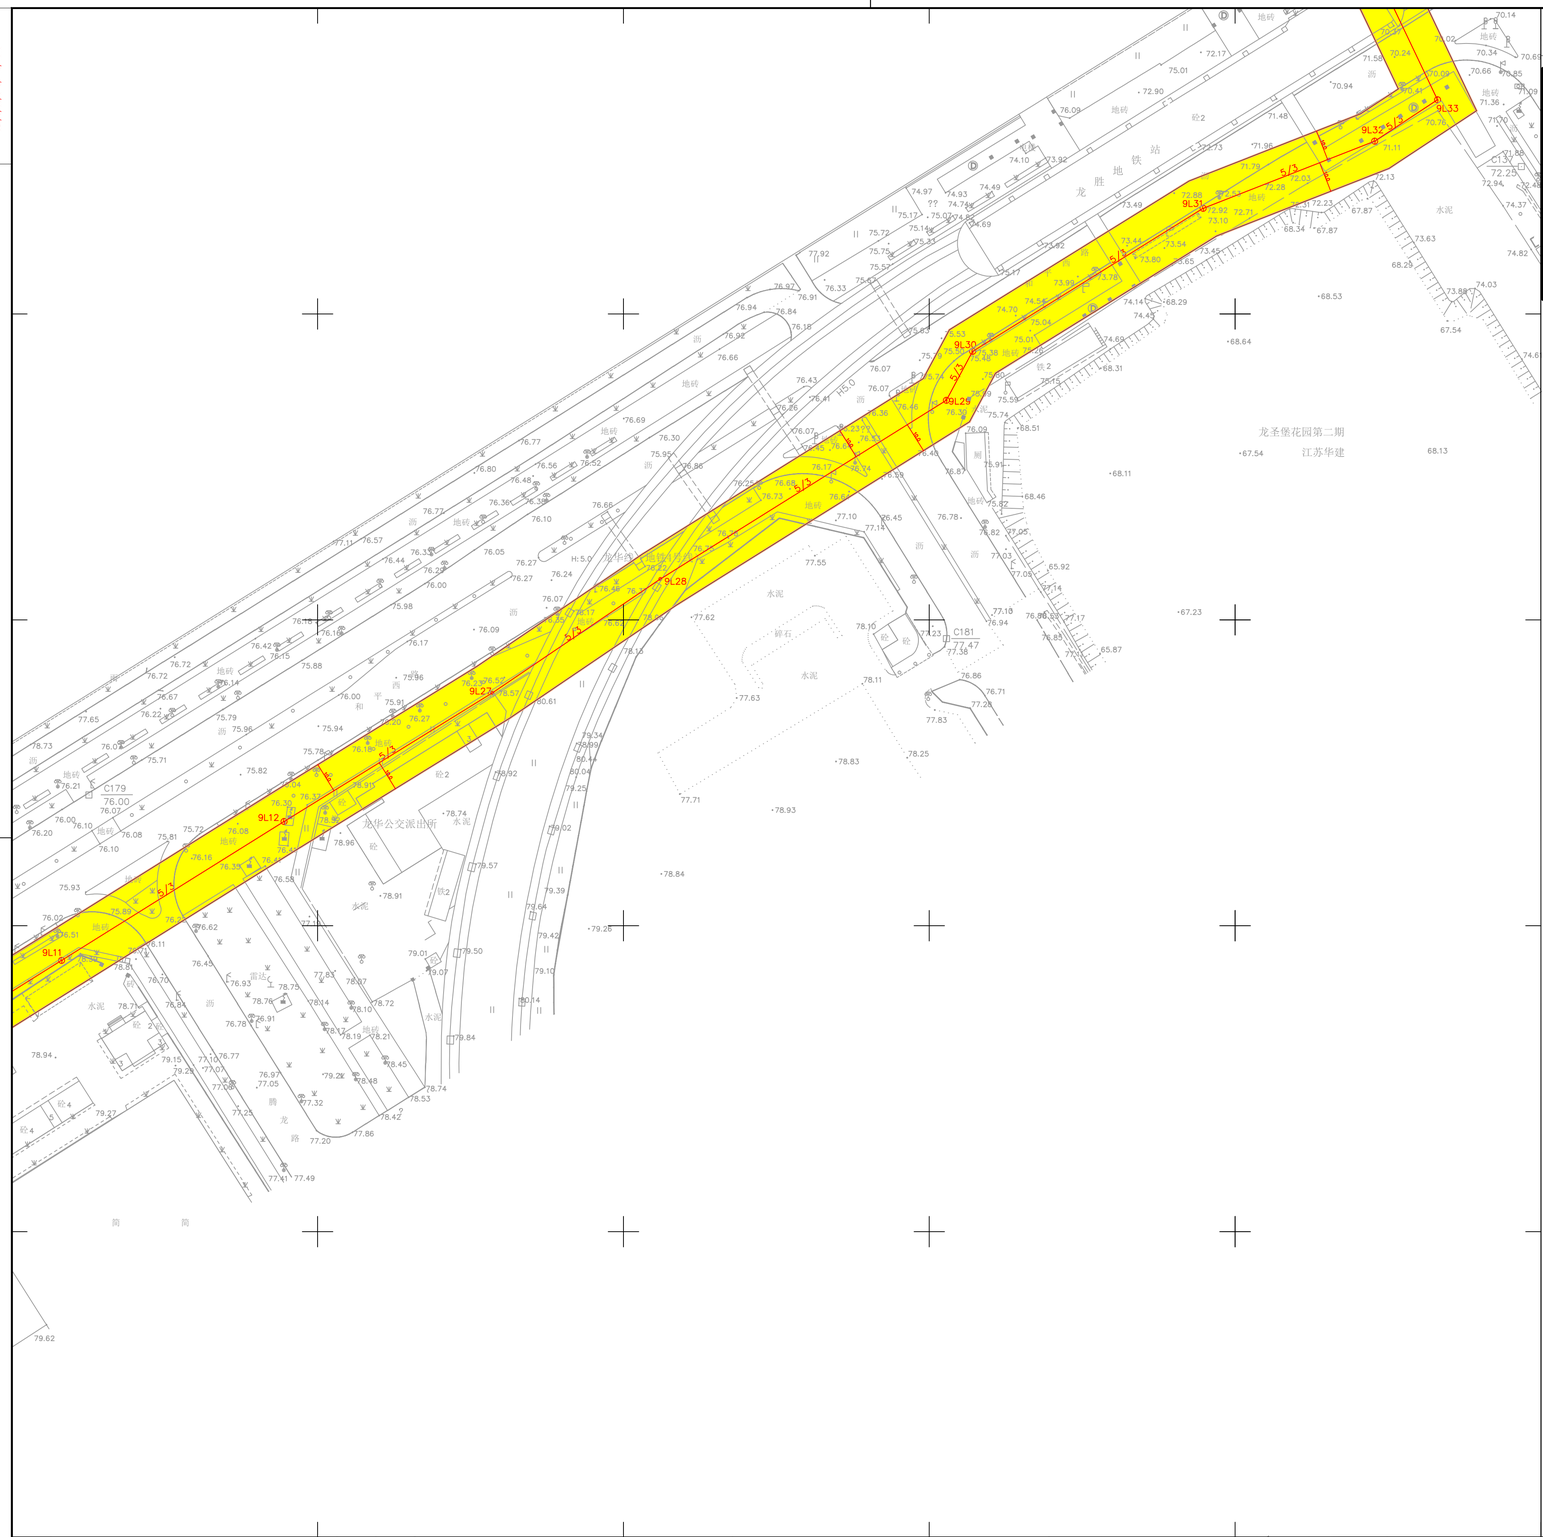

DO NOT SCALE DRAWING. VERIFY ALL DIMENSIONS ON SITE
版权所有不得复印
© MTR CORPORATION (SHENZHEN) LIMITED
COPYRIGHT IN RESPECT OF THIS DRAWING / DOCUMENT IS OWNED BY THE MTR CORPORATION LIMITED
OF HONG KONG. NO REPRODUCTION OF THE DRAWING / DOCUMENT OR ANY PART BY WHATSOEVER MEANS IS PERMITTED
WITHOUT THE PRIOR WRITTEN CONSENT OF THE MTR CORPORATION LIMITED.



说明：

1. 坐标采用深圳坐标系统，高程采用1956年黄海高程系统,等高距为1m。
2. GB/T20257.1-2007国家基本比例尺地图图式第1部分：1:500 1:1000 1:2000地形图图式。
3. 2011年6月数字化地形图。

图例：

电力管道

200	管道及管径
800X600	管道及断面尺寸
L1	检修井及点号
L2	控制柜及点号
L3	上杆及点号
L4	出入地及点号
L5	预留口及点号
L6	配电箱及点号
L7	配电房及点号
L8	未知井及点号
L9	通风井及点号
L10	管线点及点号

控制保护区边线

保护区范围线

REVISION	DESCRIPTION	BY	DATE	APPROVED

MTR港铁
1000 HePing Road, Longhua District Shenzhen,China.
Post code: 518019
Tel.:(86)0755-29276000
Tel.:(86)0755-29276001
深圳市龙华区和平路1000号
邮编：518019
电话：(86)0755-29276000
传真：(86)0755-29276001

Project Title 项目名称
深圳轨道交通4号线二期工程

会签

Drawn 绘图	FF	
Designed 设计	LQ	
Checked 检查	LQ	
Approved 审核	YH	

Scale 比例 1:1000
Date 日期 6/2/2017
As built dwg No. 竣工图号 ---

Drawing Title 图纸名称
深圳轨道交通4号线110kV长胜输电线路控制保护区图

Drawing No. 图号 SL4/B/LHD/OPD/P12/1013
Rev. 版本 A

Cad-File No. SL4/B/00/OPD/P12/1013.dwg
Disk/Tape No.